


PIPA PVC



Quality Pipes... Quality Water

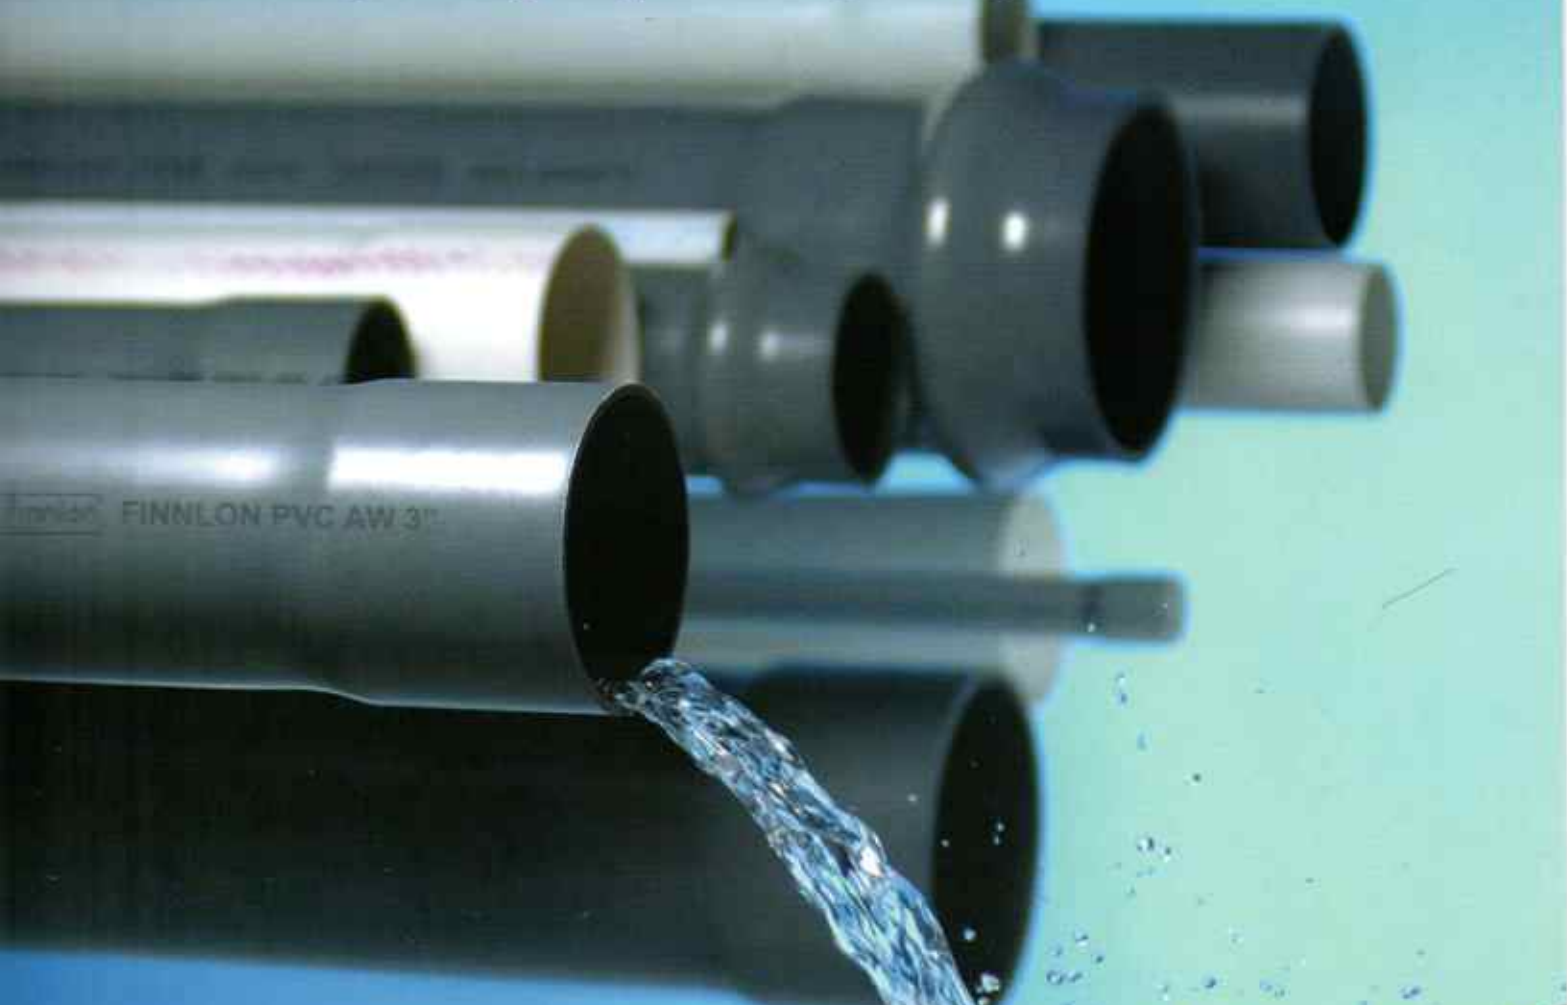

Mutu diakui  
**PDAM**



PT. INDRASARI KENCAN

**GERMAN TECHNOLOGY**




**Pipa PDAM**

Standard SII 0344 - 82 / SNI 06 - 0084 - 2002 / ISO 4422 - 1990

Nominal Diameter (mm)	Outside Diameter (mm)	THICKNESS (mm)									Panjang Per Batang (m)
		S - 6.3		S - 8		S - 10		S - 12.5		S - 16	
16	20	1.5		1.2		1.0		0.8		0.7	6.025
20	25	1.9		1.5		1.2		1.0		0.8	6.03
25	32	2.4		1.9		1.6		1.3		1.0	6.03
30	40	3.0		2.4		1.9		1.6		1.3	6.05
40	50	3.7		3.0		2.4		2.0		1.6	6.06
50	63		4.7		3.8		3.0		2.4	2.0	6.10
65	75		5.5		4.5		3.6		2.9	2.3	6.12
75	90		6.6		5.4		4.3		3.5	2.8	6.13
100	110		8.1		6.6		5.3		4.2	3.4	6.15
125	125		9.2		7.4		6.0		4.8	3.9	6.17
150	160		11.8		9.5		7.7		6.2	4.9	6.19
200	200		14.7		11.9		9.6		7.7	6.2	6.24
250	250		18.4		14.8		11.9		9.9	7.7	6.30
300	315		23.2		18.7		15.0		12.1	9.7	6.35
350	355		26.1		21.1		16.9		13.6	10.9	6.40
400	400		29.4		23.7		19.1		15.3	12.3	6.48
Working Pressure (Kg / cm <sup>2</sup> )		16		12.5		10		8		6	
		20		16.0		12.5		10		8	

**Note :**
 SCJ = Solvent Cement Joint

 SCJ/RRJ = Solvent Cement Joint/Rubber Ring Joint

 RRJ = Rubber Ring Joint